



Company:		Date:	2/17/2025
Engineer:		Page:	1
Project:			
Address:			
Phone:			
E-mail:			

1. Project information

Project description:
Location:
Design name: SIMPSON Design Per 17.10.5.3 Option D.pdf

Comment:

2. Input Data & Anchor Parameters

General

Design method: ACI 318-19
Units: Imperial units

Anchor Information:

Anchor type: Bonded anchor
Material: F1554 Grade 36
Diameter (inch): 0.625
Effective Embedment depth, h_{ef} (inch): 10.000
Code report: ICC-ES ESR-4057
Anchor category: -
Anchor ductility: Yes
 h_{min} (inch): 11.38
 c_{ac} (inch): 22.57
 C_{min} (inch): 1.75
 S_{min} (inch): 3.00

Base Material

Concrete: Normal-weight
Concrete thickness, h (inch): 18.00
State: Cracked
Compressive strength, f'_c (psi): 2500
 $\Psi_{c,v}$: 1.0
Reinforcement condition: B tension, B shear
Supplemental edge reinforcement: Not applicable
Reinforcement provided at corners: No
Ignore concrete breakout in tension: No
Ignore concrete breakout in shear: No
Hole condition: Dry concrete
Inspection: Continuous
Temperature range, Short/Long: 150/110°F
Reduced installation torque (for AT-3G): Not applicable
Ignore 6do requirement: Not applicable
Build-up grout pad: No

Recommended Anchor

Anchor Name: SET-3G™ - SET-3G w/ 5/8"Ø F1554 Gr. 36
Code Report: ICC-ES ESR-4057





Company:		Date:	2/17/2025
Engineer:		Page:	2
Project:			
Address:			
Phone:			
E-mail:			


Load and Geometry

Load factor source: ACI 318 Section 5.3
Load combination: not set
Seismic design: Yes
Anchors subjected to sustained tension: No
Ductility section for tension: 17.10.5.3 (d) is satisfied
Ductility section for shear: not satisfied
 Ω_0 factor: not set
Apply entire shear load at front row: Yes
Anchors only resisting wind and/or seismic loads: Yes

Strength level loads:

N_{ua} [lb]: 2000
 V_{uax} [lb]: 0
 V_{uay} [lb]: 0


<Figure 1>

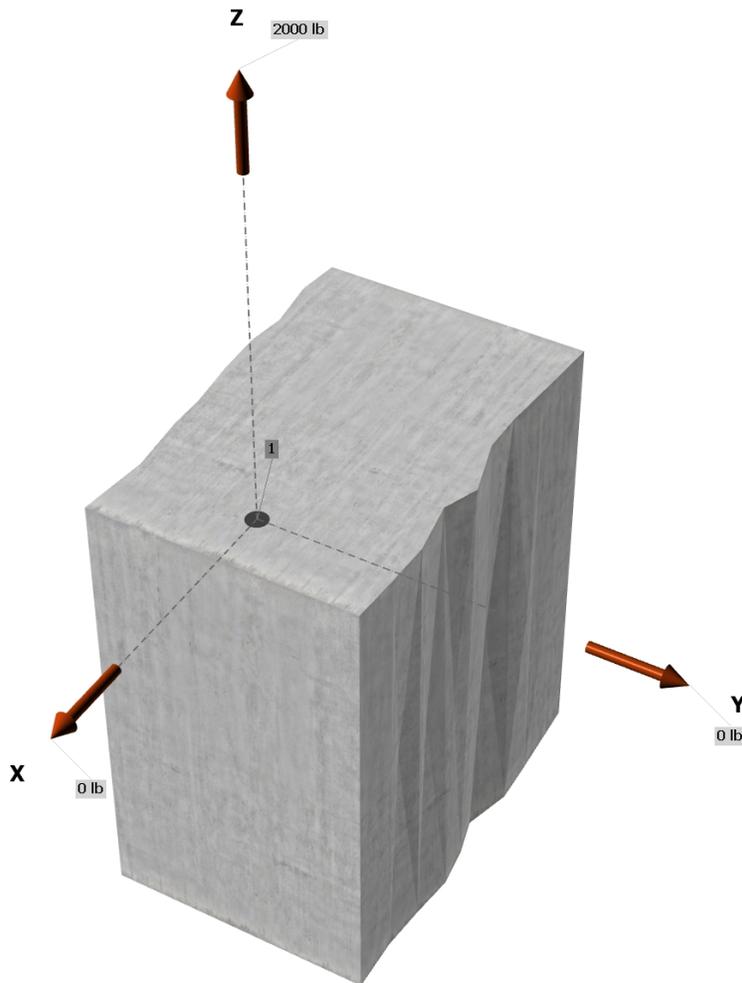



Company:		Date:	2/17/2025
Engineer:		Page:	3
Project:			
Address:			
Phone:			
E-mail:			

<Figure 2>

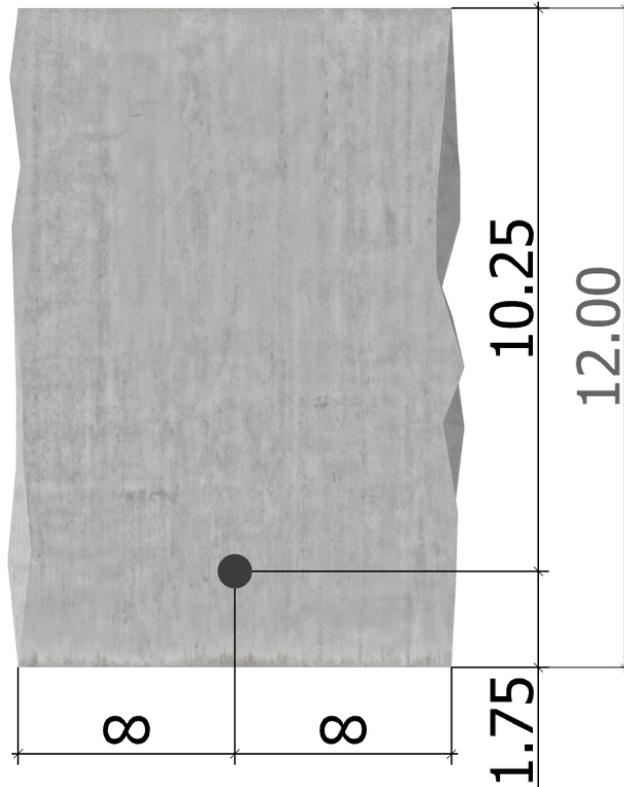

3. Resulting Anchor Forces

Anchor	Tension load, N_{ua} (lb)	Shear load x, V_{uax} (lb)	Shear load y, V_{uay} (lb)	Shear load combined, $\sqrt{(V_{uax})^2 + (V_{uay})^2}$ (lb)
1	2000.0	0.0	0.0	0.0
Sum	2000.0	0.0	0.0	0.0

Maximum concrete compression strain (%): 0.00
 Maximum concrete compression stress (psi): 0
 Resultant tension force (lb): 2000
 Resultant compression force (lb): 0
 Eccentricity of resultant tension forces in x-axis, e'_{Nx} (inch): 0.00
 Eccentricity of resultant tension forces in y-axis, e'_{Ny} (inch): 0.00



Company:		Date:	2/17/2025
Engineer:		Page:	4
Project:			
Address:			
Phone:			
E-mail:			

4. Steel Strength of Anchor in Tension (Sec. 17.6.1)

N_{sa} (lb)	ϕ	ϕN_{sa} (lb)
13110	0.75	9833

5. Concrete Breakout Strength of Anchor in Tension (Sec. 17.6.2)

$$N_b = k_c \lambda_a \sqrt{f'_c} h_{ef}^{1.5} \text{ (Eq. 17.6.2.2.1)}$$

k_c	λ_a	f'_c (psi)	h_{ef} (in)	N_b (lb)
17.0	1.00	2500	10.000	26879

$$0.75 \phi N_{cb} = 0.75 \phi (A_{Nc} / A_{Nco}) \Psi_{ed,N} \Psi_{c,N} \Psi_{cp,N} N_b \text{ (Sec. 17.5.1.2 \& Eq. 17.6.2.1a)}$$

A_{Nc} (in ²)	A_{Nco} (in ²)	$c_{a,min}$ (in)	$\Psi_{ed,N}$	$\Psi_{c,N}$	$\Psi_{cp,N}$	N_b (lb)	ϕ	$0.75 \phi N_{cb}$ (lb)
360.00	900.00	1.75	0.735	1.00	1.000	26879	0.65	3852

6. Adhesive Strength of Anchor in Tension (Sec. 17.6.5)

$$\tau_{k,cr} = \tau_{k,cr,short-term} K_{sat} (f'_c / 2,500)^n \alpha_{N,seis}$$

$\tau_{k,cr}$ (psi)	$f_{short-term}$	K_{sat}	$\alpha_{N,seis}$	f'_c (psi)	n	$\tau_{k,cr}$ (psi)
1356	1.00	1.00	1.00	2500	0.24	1356

$$N_{ba} = \lambda_a \tau_{cr} \pi d_a h_{ef} \text{ (Eq. 17.6.5.2.1)}$$

λ_a	τ_{cr} (psi)	d_a (in)	h_{ef} (in)	N_{ba} (lb)
1.00	1356	0.63	10.000	26625

$$0.75 \phi N_a = 0.75 \phi (A_{Na} / A_{Na0}) \Psi_{ed,Na} \Psi_{cp,Na} N_{ba} \text{ (Sec. 17.5.1.2 \& Eq. 17.6.5.1a)}$$

A_{Na} (in ²)	A_{Na0} (in ²)	c_{Na} (in)	$c_{a,min}$ (in)	$\Psi_{ed,Na}$	$\Psi_{cp,Na}$	N_{a0} (lb)	ϕ	$0.75 \phi N_a$ (lb)
184.22	307.10	8.76	1.75	0.760	1.000	26625	0.65	5917

11. Results

Interaction of Tensile and Shear Forces (Sec. 17.8)

Tension	Factored Load, N_{ua} (lb)	Design Strength, ϕN_n (lb)	Ratio	Status
Steel	2000	9833	0.20	Pass
Concrete breakout	2000	3852	0.52	Pass (Governs)
Adhesive	2000	5917	0.34	Pass

Input data and results must be checked for agreement with the existing circumstances, the standards and guidelines must be checked for plausibility.



Company:		Date:	2/17/2025
Engineer:		Page:	5
Project:			
Address:			
Phone:			
E-mail:			

SET-3G w/ 5/8"Ø F1554 Gr. 36 with hef = 10.000 inch meets the selected design criteria.

12. Warnings

- Per designer input, ductility requirements for tension have been determined to be satisfied – designer to verify.
- Designer must exercise own judgement to determine if this design is suitable.
- Refer to manufacturer's product literature for hole cleaning and installation instructions.